
UNIT ATW 112-6J ELECTRIC WATER LEVEL CONTROL LOCATION

EVAPCO, INC. Evapeo



DWG. # **ELALMW00-DE** SCALE JLG N.T.S.

UNIT SELECTED	BOX SIZE	VALVE			Y-STRAINER			STANDPIPE		
		QTY	SIZE	PART NO.	QTY	SIZE	PART NO.	QTY	Х	Υ
	3x6	1	3/4" [19]	017-00152P	1	3/4" [19]	017-00279P	1	3'-2" [965]	7 9/16" [192]
	5x6	1	3/4" [19]	017-00152P	1	3/4" [19]	017-00279P	1	3'-2" [965]	7 9/16" [192]
	5x9	1	3/4" [19]	017-00152P	1	3/4" [19]	017-00279P	1	5'-10" [1778]	7 9/16" [192]
	5x12	1	1" [25]	017-00153P	1	1" [25]	017-00280P	1	9'-1" [2769]	7 9/16" [192]
	8x9	1	1" [25]	017-00153P	1	1" [25]	017-00280P	1	5'-10" [1778]	7 9/16" [192]
	8x12	1	1" [25]	017-00153P	1	1" [25]	017-00280P	1	9'-1" [2769]	7 9/16" [192]

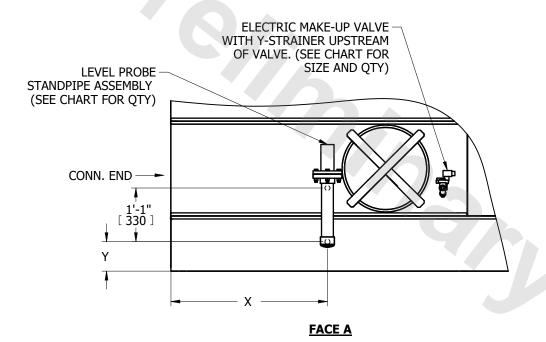

- 1. PIPING BY OTHERS.
- 2. LEVEL PROBE STANDPIPE ASSEMBLY, MAKE-UP VALVE AND Y-STRAINER TO SHIP LOOSE FOR FIELD MOUNTING BY OTHERS.
- 3. SEE CERTIFIED PRINT FOR MAKE-UP LOCATION.
- 4. STANDPIPE TO BE HEAT TRACED AND INSULATED FOR WINTER OPERATION (BY OTHERS).
- 5. THE ELECTRONIC WATER LEVEL CONTROL ON THIS UNIT WILL MAINTAIN THE PROPER OPERATING WATER LEVEL. HOWEVER, BEFORE INITIAL START-UP THE UNIT MUST BE MANUALLY FILLED TO WITHIN 1" OF THE OVERFLOW.
- 6. FOR EASE OF MAINTENANCE, A SHUT-OFF VALVE IS RECOMMENDED UPSTREAM OF Y-STRAINER.
- 7. DIMENSIONS LISTED AS FOLLOWS: ENGLISH FT-IN [METRIC] [mm]