
UNIT	ATW 112-4K	
TITLE		
l	ELECTRIC WATER LEVEL CONTROL LOCATION	

EVAPCO, INC. Evapeo



DWG. # **ELALMW00-DE** SCALE JLG N.T.S.

UNIT	BOX SIZE	ROX SIZE VALVE		Y-STRAINER			STANDPIPE								
SELECTED	SELECTED	BOX SEE	QTY	SIZE	PART NO.	QTY	SIZE	PART NO.	QTY	Х	Υ				
	3x6	3v6	1	3/4"	017-00152P	1	3/4"	017-00279P	1	3'-2"	7 9/16"				
			[19]	19]	' [19]	017-002791		[965]	[192]						
	5x6	k6 1	3/4"	017-00152P	1	1 3/4"	017-00279P	1	3'-2"	7 9/16"					
			[19]	[19]	[19]	017-002791	1	[965]	[192]						
	5x9	5v0	5v0 1	3/4"	017-00152P	1 3/4"	017-00279P	1	5'-10"	7 9/16"					
		'	[19]	017-00132F	. '	[19]			[1778]	[192]					
	5x12	5v12	1	1" 017-00153P	1	1"	017-00280P	1	9'-1"	7 9/16"					
		'	[25]	017-001331		[25]			[2769]	[192]					
	]	8x9	8×0	8v0	8v0	8v0	1	1"	017-00153P	1	1"	017-00280P	1	5'-10"	7 9/16"
	OXO		[25]	017-001001	'	[25]	017-002001	1	[1778]	[192]					
	8v12	8x12 1	8v12 1 1" 017-00153	017-00153P	1	1"	017-00280P	1	9'-1"	7 9/16"					
	OXIZ		[25]	017-001001	'	[25]	017-002001	'	[2769]	[192]					

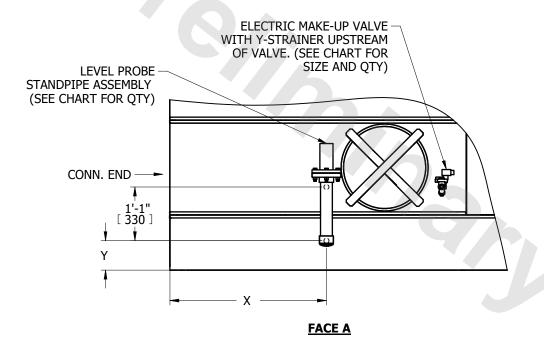

- 1. PIPING BY OTHERS.
- 2. LEVEL PROBE STANDPIPE ASSEMBLY, MAKE-UP VALVE AND Y-STRAINER TO SHIP LOOSE FOR FIELD MOUNTING BY OTHERS.
- 3. SEE CERTIFIED PRINT FOR MAKE-UP LOCATION.
- 4. STANDPIPE TO BE HEAT TRACED AND INSULATED FOR WINTER OPERATION (BY OTHERS).
- 5. THE ELECTRONIC WATER LEVEL CONTROL ON THIS UNIT WILL MAINTAIN THE PROPER OPERATING WATER LEVEL. HOWEVER, BEFORE INITIAL START-UP THE UNIT MUST BE MANUALLY FILLED TO WITHIN 1" OF THE OVERFLOW.
- 6. FOR EASE OF MAINTENANCE, A SHUT-OFF VALVE IS RECOMMENDED UPSTREAM OF Y-STRAINER.
- 7. DIMENSIONS LISTED AS FOLLOWS: ENGLISH FT-IN [METRIC] [mm]