
LPT-316

UNIT

TITLE

STEEL SUPPORT CONFIGURATION

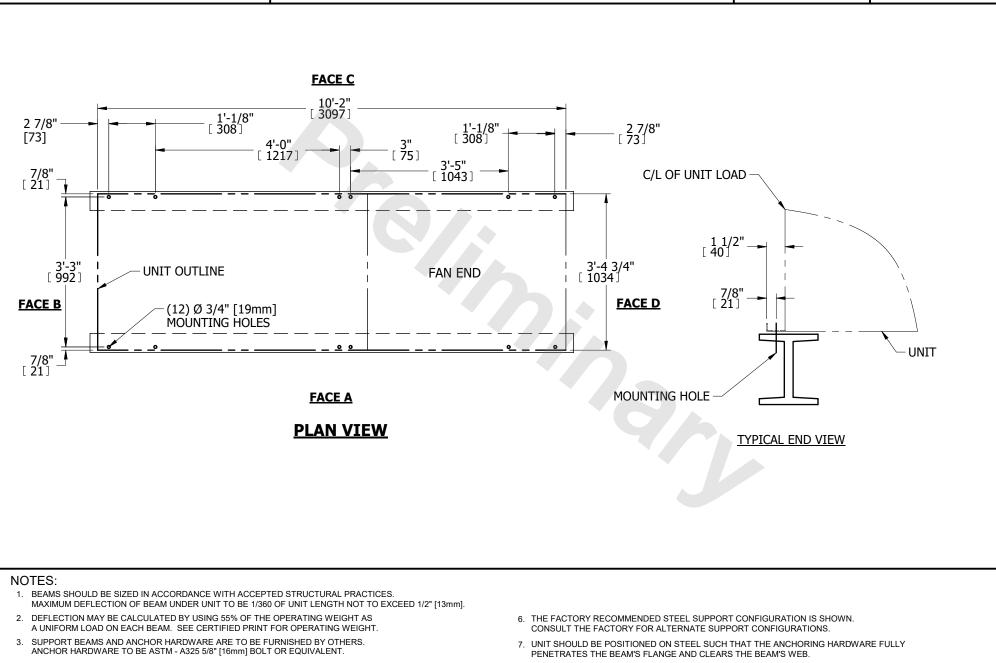

EVAPCO, INC.

 BEAMS MUST BE LOCATED UNDER THE FULL LENGTH OF THE PAN SECTION.
SUPPORTING BEAM SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY PLACING SHIMS BETWEEN THE UNIT MOUNTING FLANGE AND THE SUPPORTING BEAM. 8. DIMENSIONS LISTED AS FOLLOWS: ENGLISH FT-IN [METRIC] [mm]

DWG. #

SCALE

N.T.S.

SLAL30306-DC

DRAWN BY

JLG